



Sweetwater Environmental Management, LLC

720 East Landis Avenue, Rear
Vineland, New Jersey 08360

School Potable Water System Lead Testing

**Main Road School
1452 Main Road
Newfield, NJ 08344**

07/31/2017

Prepared By:
Frederick J. Gross, REM • CEA • LO
Sweetwater Environmental Management, LLC

Drinking Water Outlet Inventory & Results

Name of School: Main Road School Address: 1452 Main Road, Newfield NJ 08344

Date Completed: 7-12-2017

#	Outlet Type	Location	Code	Lead Result ug/l	Lead Limit ug/l	Map ID	Comments
1	Water Cooler	North Central Hall	MRS-NCHL-WC-01	<1	15	01	SAMPLE, Incompliance
2	Sink	Kitchen	MRS-RM26-KC-02	<1	15	02	SAMPLE, Incompliance
3	Sink	Kitchen	MRS-RM26-KC-03	2.31	15	03	SAMPLE, Incompliance
4	Sink	Kitchen	MRS-RM26-HB-04	N/A	N/A	04	Non-Drinking Water Outlet, No Sample
5	Sink	Kitchen	MRS-RM26-DS-05	N/A	N/A	05	Non-Drinking Water Outlet, No Sample
6	Bubbler	North Hall	MRS-NHL-DW-06	2.61	15	06	SAMPLE, Incompliance
7	Sink	North Hall Boy's Room	MRS-NHLB-BS-07	N/A	N/A	07	Non-Drinking Water Outlet, No Sample
8	Sink	North Hall Boy's Room	MRS-NHLB-BS-08	N/A	N/A	08	Non-Drinking Water Outlet, No Sample
9	Sink	North Hall Boy's Room	MRS-NHLB-BS-9	N/A	N/A	09	Non-Drinking Water Outlet, No Sample
10	Sink	North Hall Boy's Room	MRS-NHLB-BS-10	N/A	N/A	10	Non-Drinking Water Outlet, No Sample
11	Sink	North Hall Girl's Room	MRS-NHLG-BS-11	N/A	N/A	11	Non-Drinking Water Outlet, No Sample
12	Sink	North Hall Girl's Room	MRS-NHLG-BS-12	N/A	N/A	12	Non-Drinking Water Outlet, No Sample
13	Sink	North Hall Girl's Room	MRS-NHLG-BS-13	N/A	N/A	13	Non-Drinking Water Outlet, No Sample
14	Sink	North Hall Girl's Room	MRS-NHLG-BS-14	N/A	N/A	14	Non-Drinking Water Outlet, No Sample
15	Bubbler	North West Hall	MRS-NWHL-DW-15	<1	15	15	SAMPLE, Incompliance
16	Sink	Room 33	MRS-RM33-BS-16	N/A	N/A	16	Non-Drinking Water Outlet, No Sample

* ug/l = Micrograms per Liter or Parts per Billion

TABLE KEY

	Sample collected, the result was less than the LEAD Action Limit (15 ug/l), sample is acceptable for potable water.
	Sample collected, the result was greater than the LEAD Action Limit (15 ug/l), outlet was removed and plumbing sealed.
N/A	NO Sample collected, outlet exempted, NOT A DRINKING WATER SOURCE, sanitation only hand wash or equipment sink

#	Outlet Type	Location	Code	Lead Result ug/l	Lead Limit ug/l	Map ID	Comments
17	Sink	Room 31	MRS-RM31-OC-17	<1	15	17	SAMPLE, Incompliance
18	Sink	Room 31	MRS-RM31-BS-18	N/A	N/A	18	Non-Drinking Water Outlet, No Sample
19	Water Cooler	South Central Hall	MRS-SCHL-WC-19	<1	15	19	SAMPLE, Incompliance
20	Sink	Room 10	MRS-RM10-TL-20	1.05	15	20	SAMPLE, Incompliance
21	Sink	Room 11	MRS-RM11-BS-21	N/A	N/A	21	Non-Drinking Water Outlet, No Sample
22	Sink	Room 11	MRS-RM11BS-22	N/A	N/A	22	Non-Drinking Water Outlet, No Sample
23	Bubbler	South East Hall	MRS-SEHL-DW-23	<1	15	23	SAMPLE, Incompliance
24	Sink	South East Hall Girl's Room	MRS-SEHG-BS-24	N/A	N/A	24	Non-Drinking Water Outlet, No Sample
25	Sink	South East Hall Girl's Room	MRS-SEHG-BS-25	N/A	N/A	25	Non-Drinking Water Outlet, No Sample
26	Sink	South East Hall Girl's Room	MRS-SEHG-BS-26	N/A	N/A	26	Non-Drinking Water Outlet, No Sample
27	Sink	South East Hall Girl's Room	MRS-SEHG-BS-27	N/A	N/A	27	Non-Drinking Water Outlet, No Sample
28	Sink	South East Hall Boy's Room	MRS- SEHB-BS-29	N/A	N/A	29	Non-Drinking Water Outlet, No Sample
29	Sink	South East Hall Boy's Room	MRS-SEHB-BS-30	N/A	N/A	30	Non-Drinking Water Outlet, No Sample
30	Sink	South East Hall Boy's Room	MRS-SEHB-BS-31	N/A	N/A	31	Non-Drinking Water Outlet, No Sample
31	Sink	South East Hall Boy's Room	MRS-SEHB-BS-32	N/A	N/A	32	Non-Drinking Water Outlet, No Sample
32	Bubbler	South Hall	MRS-SHL-DW-33	4.3	15	33	SAMPLE, Incompliance
33	Sink	Nurse's Office	MRS-NURS-NS-34	N/A	N/A	34	Non-Drinking Water Outlet, No Sample
34	Sink	Nurse's Office	MRS-NURS-BS-35	N/A	N/A	35	Non-Drinking Water Outlet, No Sample
35	Sink	Nurse's Office	MRS-NURS-BS-36	N/A	N/A	36	Non-Drinking Water Outlet, No Sample
36	Sink	Nurse's Office	MRS-NURS-BS-37	N/A	N/A	37	Non-Drinking Water Outlet, No Sample
37	Bubbler	South East Hall	MRS-SEHL-DW-38	<1	15	38	SAMPLE, Incompliance
38	Sink	Room 13	MRS-RM13-AS-39	N/A	N/A	39	Non-Drinking Water Outlet, No Sample
39	Water Cooler	South East Hall	MRS-SEHL-WC-40	<1	15	40	SAMPLE, Incompliance

* ug/l = Micrograms per Liter or Parts per Billion

TABLE KEY

Sample collected, the result was less than the LEAD Action Limit (15 ug/l), sample is acceptable for potable water.

Sample collected, the result was greater than the LEAD Action Limit (15 ug/l), outlet was removed and plumbing sealed.


N/A NO Sample collected, outlet exempted, NOT A DRINKING WATER SOURCE, sanitation only hand wash or equipment sink


#	Outlet Type	Location	Code	Lead Result ug/l	Lead Limit ug/l	Map ID	Comments
40	Sink	East Hall Boy's Room	MRS-EHLB-BS-41	N/A	N/A	41	Non-Drinking Water Outlet, No Sample
41	Sink	East Hall Boy's Room	MRS-EHLB-BS-42	N/A	N/A	42	Non-Drinking Water Outlet, No Sample
42	Sink	East Hall Boy's Room	MRS-EHLG-BS-43	N/A	N/A	37	Non-Drinking Water Outlet, No Sample
43	Water Cooler	East Hall	MRS-ESHL-WC-44	<1	15	38	SAMPLE, Incompliance
44	Water Cooler	East Hall	MRS-ESHL-WC-45	<1	15	39	SAMPLE, Incompliance
45	Sink	East Hall Girl's Room	MRS-EHLG-BS-46	N/A	N/A	39.1	Non-Drinking Water Outlet, No Sample
46	Sink	East Hall Girl's Room	MRS-EHLG-BS-47	N/A	N/A	40	Non-Drinking Water Outlet, No Sample
47	Sink	East Hall Girl's Room	MRS-EHLG-BS-48	N/A	N/A	48	Non-Drinking Water Outlet, No Sample
48	Sink	Room 61	MRS-RM61-BS-49	N/A	N/A	49	Non-Drinking Water Outlet, No Sample

* ug/l = Micrograms per Liter or Parts per Billion

TABLE KEY

	Sample collected, the result was less than the LEAD Action Limit (15 ug/l), sample is acceptable for potable water.
	Sample collected, the result was greater than the LEAD Action Limit (15 ug/l), outlet was removed and plumbing sealed.
N/A	NO Sample collected, outlet exempted, NOT A DRINKING WATER SOURCE, sanitation only hand wash or equipment sink

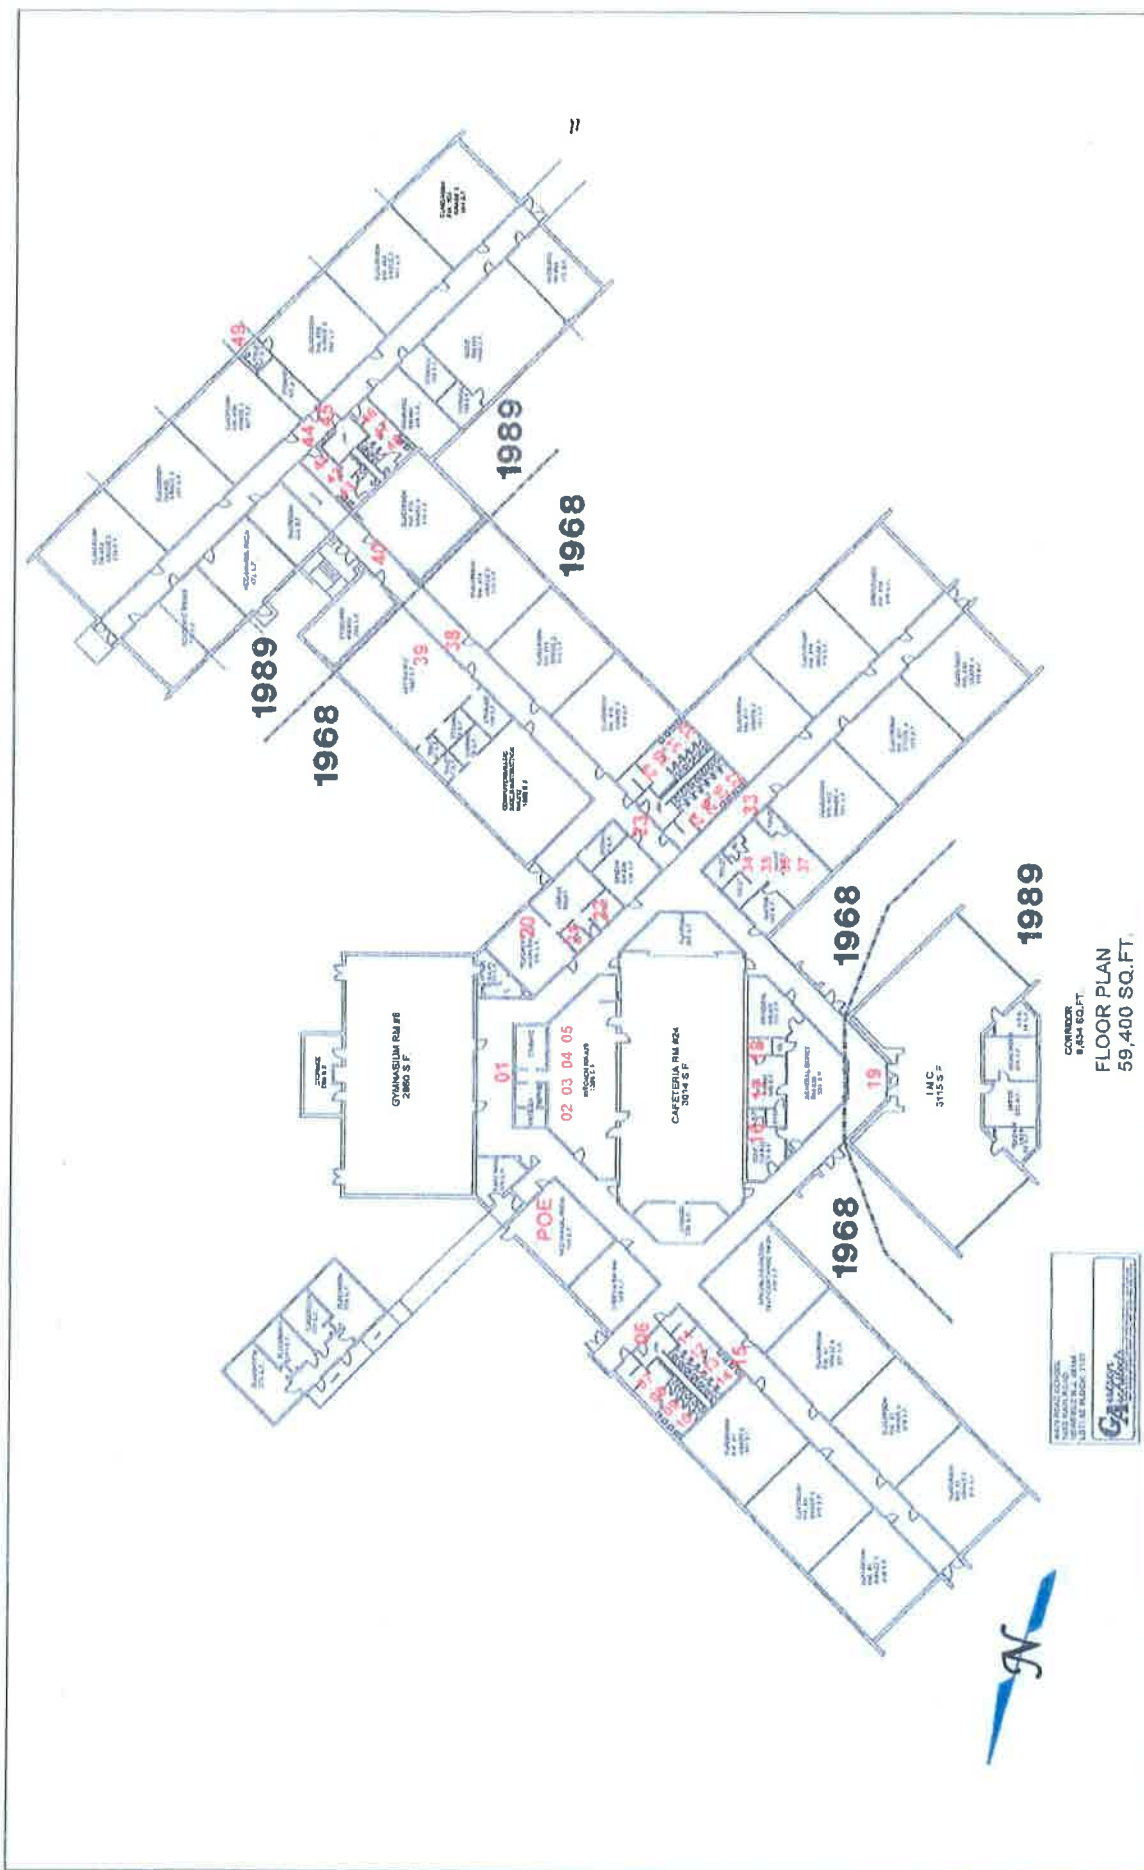

 <p>720 East Landis Avenue, Rear Vineland, NJ 08360 Phone: (856) 205-1999 Fax: (856) 205-1825</p>		<p>Potable Water Inventory / Lead Sampling Map Main Road School 1452 Main Road Newfield, NJ 08344</p>		<p>FIGURE 1</p>
<p>DRAWN BY FJG</p>	<p>FILE FBE</p>	<p>DATE 06/30/2017</p>	<p>SCALE NITS</p>	<p>PREPARED FOR: Franklin Township Board of Education</p>
<p>FLOOR PLAN 59,400 SQ.FT.</p>				